


Clayton County Board of Health
Environmental Health Office
 678/610-7199

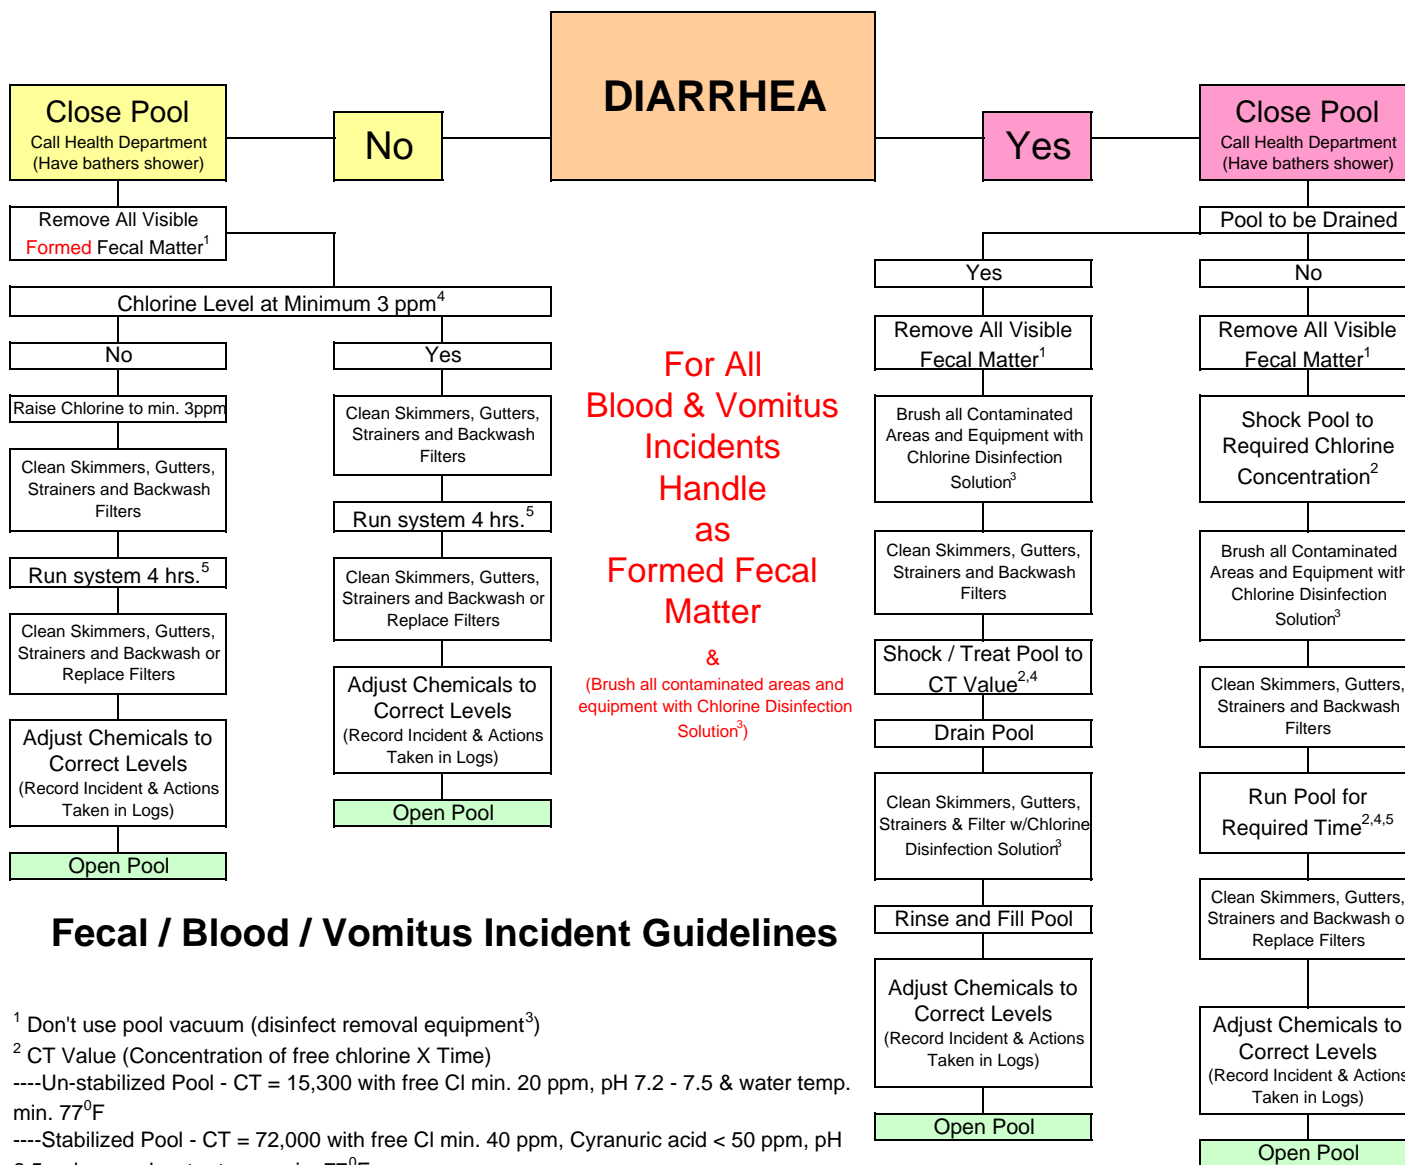

¹ Don't use pool vacuum (disinfect removal equipment³)

² CT Value (Concentration of free chlorine X Time)

----Un-stabilized Pool - CT = 15,300 with free Cl min. 20 ppm, pH 7.2 - 7.5 & water temp. min. 77⁰F

----Stabilized Pool - CT = 72,000 with free Cl min. 40 ppm, Cyanuric acid < 50 ppm, pH 6.5 or less and water temp. min. 77⁰F

³ Sixteen ounces (1 pint) of household bleach with one gallon water (Soak area 30 min.)

⁴ Maintain free chlorine concentration through-out Run Time and through-out entire pool

⁵ Ensure all equipment, slides, mushrooms, etc. continue running